


I'm not robot  reCAPTCHA


[Continue](#)

**TRANE**  
**Installation**  
**Operation**  
**Maintenance**

CG-5VX02B-EN

Library	Service Literature
Product Section	Refrigeration
Product	Rotary Scroll Liquid Chillers, Air-Cooled
Model	CG
Literature Type	Installation, Operation & Maintenance
Classification	CG
Date	January 2005
File No.	5VX02B-EN
Subclass	CG-5VX02B-EN-003

**IntelliPak™**  
 Air-Cooled Cold Generator

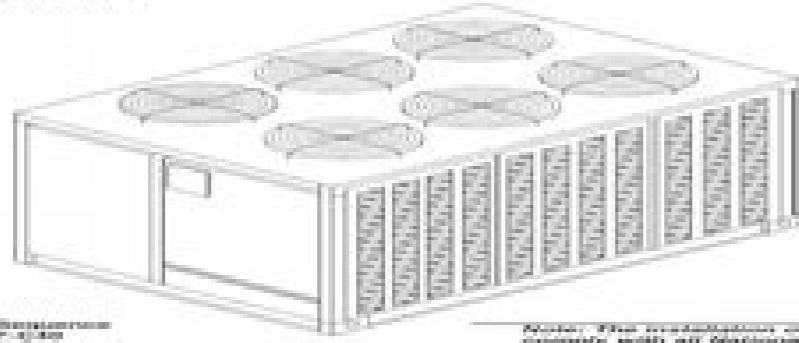

**Models**  
 CG-5VX02B-EN  
 CG-5VX02B-EN  
 CG-5VX02B-EN

**With 3-1/2" Scroll Compressor**

Note: For installation of this equipment must comply with all National, State and Local Codes.


Trane has a policy of continuous product and product data improvement and reserves the right to change the data and illustrations without notice. Only qualified engineering firms authorized by Trane should receive copies of equipment literature for their publications.

© 2005 American Standard Inc. All rights reserved.  
<http://www.trane.com>

**TRANE** RTAA/RTWA  
 Air-Cooled/Water-Cooled  
 Rotary Liquid Chillers

**Installation**  
**Operation**  
**Maintenance**

**PDF**

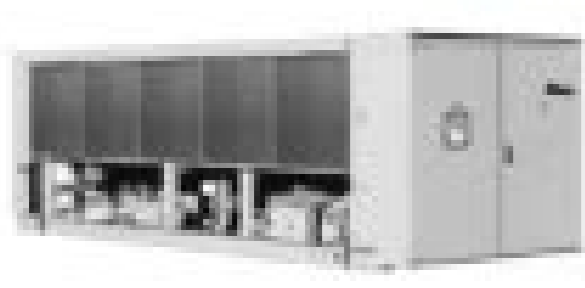

RTAA/RTWA  
 Air-Cooled/Water-Cooled  
 Rotary Liquid Chillers

RTAA/RTWA  
 Air-Cooled/Water-Cooled  
 Rotary Liquid Chillers



## Diagnostic Troubleshooting Repair

**Series R®**  
 70-125 Ton Air-Cooled and Water-Cooled  
 Rotary Liquid Chillers



**Model**  
 RTAA 70-125 Ton  
 RTWA 70-125 Ton  
 RTUA 70-125 Ton

August 2005 RLC-SVD03A-EN

